




10EGKB

15EGKB

Ventilating Fan Hood Series

Moisture & Smell Exhauster

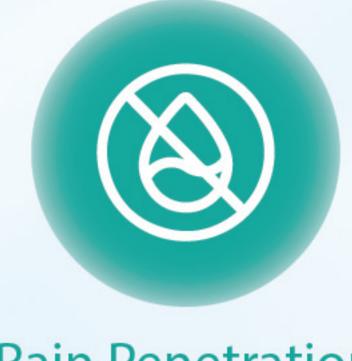

Rain Penetration Protection




Easy Installation



Energy Saving


Speedy Odour Exhaustion

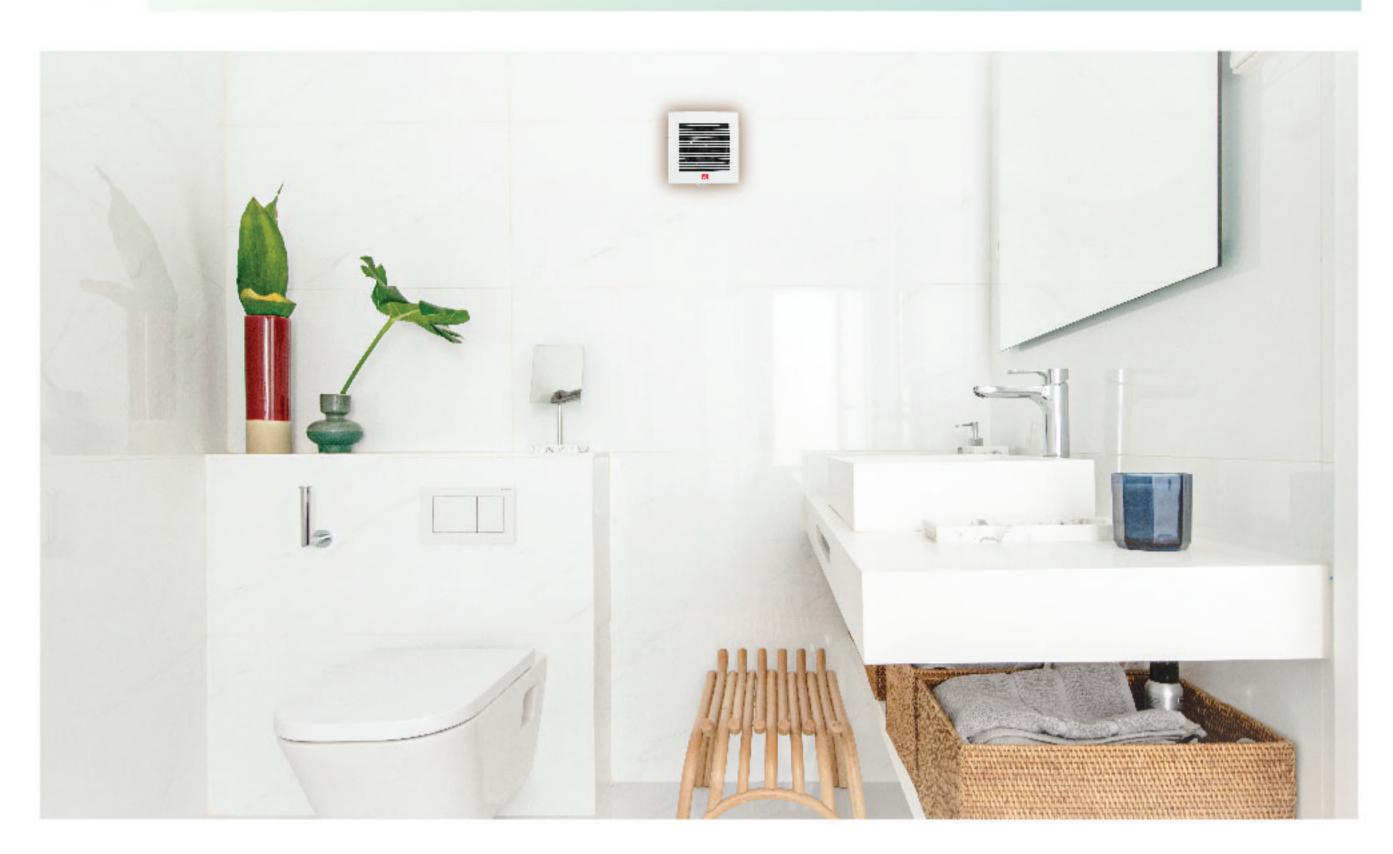

Foul smell can be quite noticeable after using the toilet. This unpleasant odour can stay without good ventilation. KDK ventilating fan can exhaust smelly air to resume a fresh comfortable room.

Excess Moisture Removal



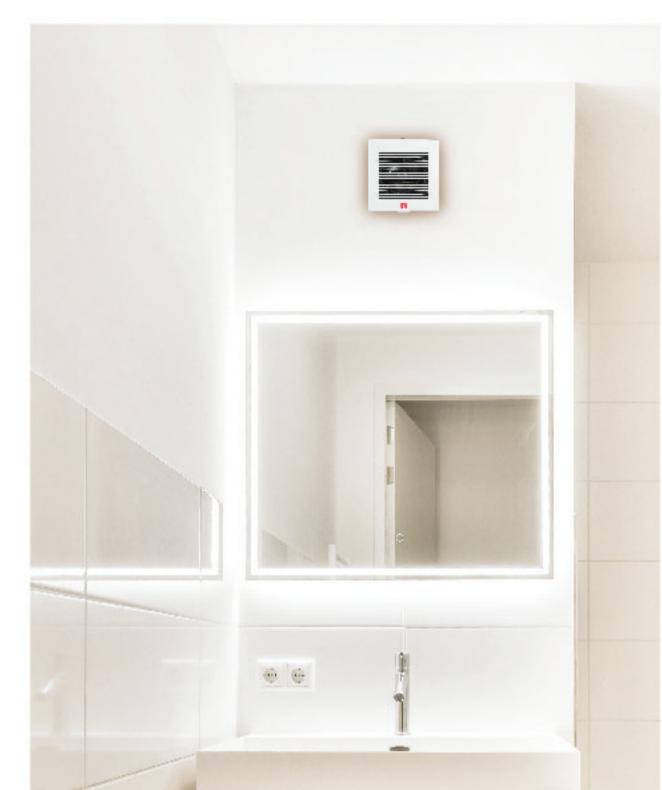

Excess moisture in your bathroom creates conditions for molds to grow. This may deteriorate the room interior and cause potential threats to health. KDK ventilating fan can remove moist air to prevent these potential risks.



Compact & Stylish


Hood Series


- Low noise level
- Low energy consumption
- Pipe hood equipped
- Protection from rain penetration
- Safety / Thermal Fuse





All accessories included

Dimension (Unit:mm)

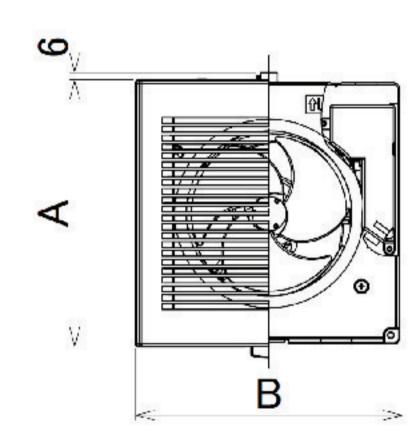

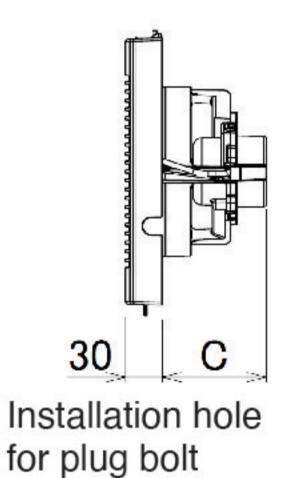

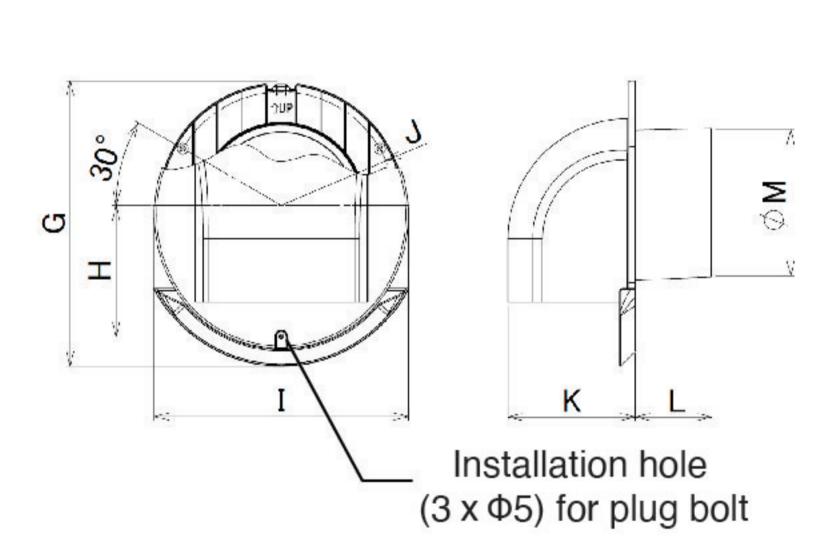

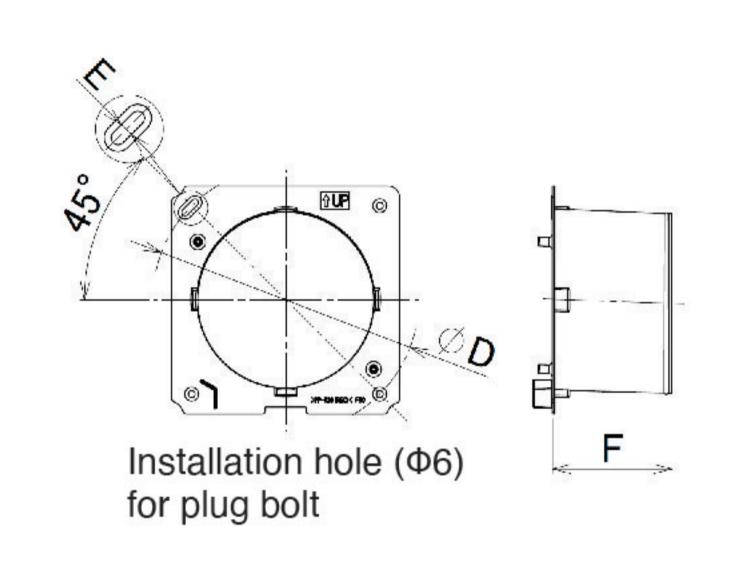

Model	Α	В	С	D	E	F	G	Н	1	J	K	L	M
10EGKB	170	170	83	177	6	100	250	107	220	99	99	82	118
15EGKB	220	220	86	231	6	100	310	142	270	123	138	82	161

Specification

Model	Voltage [V]	Frequency [Hz]	Air Volume [CMH]	Consumption [W]	Noise [dB(A)]	Speed [RPM]	Wall	Installation	Ceiling Installation	Net Weight [kg]
							Hole Size [mm]	Wall Thickness [mm]	Hole Size [mm]	
10EGKB	110	60	80	3.4	35.0	2,740	Ø130~140	100~150	Ø130~140	1.0
	220	50	76	4.3	33.0	2,660				
	230	50	77	4.6	33.0	2,675				
	240	50	77	5.0	33.0	2,690				
15EGKB	110	60	172	5.8	38.5	2,270		100~150	Ø175~185	1.3
	220	50	162	5.7	36.0	2,265	Ø175~185			
	230	50	165	6.1	37.0	2,330				
	240	50	165	6.5	37.0	2,390				

Notes:

- 1. The value of power consumption, air volume and noise are specified at the static pressure of 0 Pa.
- 2. The value of air volume is the mean value which is measured by our company.
- 3. The value of noise level is measured at 1m apart from the left, the right and the directly below of product, then get the average of three values.
- 4. The value of noise level is A weight average sound pressure level, the mean value is measured by our company.

